


CODE	IT201510001
TITLE	TAQUET SETTING
DATE	14/12/2015

✓ TAQUET SETTING

NUMBER OF TAQUETS (220V / 50Hz)					
MODEL	TIMER	AIR CONDENSER		WATER CONDENSER	
		EXTERNAL GEAR	INTERNAL GEAR	EXTERNAL GEAR	INTERNAL GEAR
NG ALFA DP30	380C	4	6	4	6
	4864C	6	8	6	8
NG ALFA DP35	380C	2 x 4	2 x 6	2 x 4	2 x 6
	4864C	6	8	6	8
NG ALFA DP45	380C	2 x 4	2 x 6	2 x 4	2 x 6
	4864C	6	8	6	8
NG ALFA DP60	380C	2 x 4	2 x 6	2 x 4	2 x 6
	4864	6	8	6	8
NG ALFA DP80	4864C	8	10	8	10
NG ALFA DP110	4864C	11	13	11	13
MDP ALFA 150	4864C	10	12	10	12
NG GALA DP30	4864C	4	6	4	6
	380C	6	8	6	8
NG GALA DP35	4864C	9	11	8	10
	380C	6	8	6	8
NG GALA DP45	4864C	7	9	8	10
	380C	7	9	7	9
NG GALA DP60	4864C	9	11	8	10
	380C	7	9	7	9
NG GALA DP80	380C	9	11	9	11
NG GALA DP110	380C	9	11	9	11
NG GALA DP150	380C	9	11	9	11
MDP GALA 150	380C	7	9	7	9
NG DELTA DP30	4864C	4	6	4	6
	380C	6	8	6	8
NG DELTA DP35	4864C	9	11	9	11
	380C	6	8	6	8
NG DELTA DP45	4864C	7	9	8	10
	380C	7	9	7	9
NG DELTA DP60	4864C	9	11	9	11
	380C	7	9	7	9
NG DELTA DP80	380C	9	11	9	11
NG DELTA DP110	380C	9	11	9	11
NG DELTA DP150	380C	9	11	9	11
MDP DELTA 150	380C	7	9	7	9

Number of taquets under standard temp. conditions. This number may vary under different ambient/water temp.

✓ **TIMER WIRING**

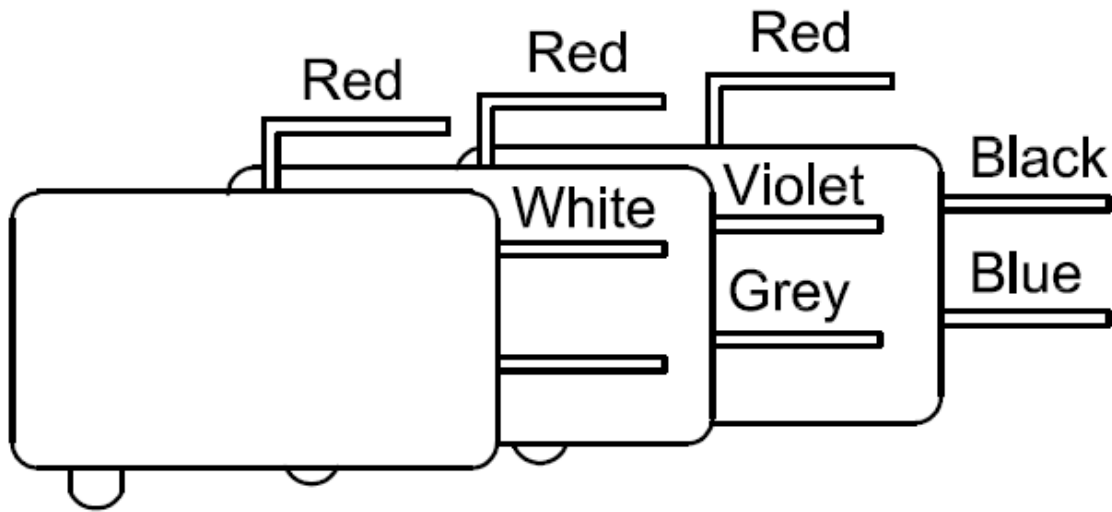

Micro-switch connection
CDC timer (grey)